


SOUND ABSORPTION AREA FOR OBJECT

Measured and evaluated according to SS-EN ISO 354 and SS 25269

CLIENT: EKOUS
 OBJECT: Quadro, 6 pcs mounted directly on wall + 30 mm min. wool
 Size [mm]: w = 1800 h = 1200 t = 45

1/3 octave band (Hz)	Equivalent sound absorption area / unit (m ² Sabine)	
	1/3 octave band	Octave band
50	0,00	
63	0,07	0,1
80	0,24	
100	0,36	
125	0,39	0,4
160	0,40	
200	0,74	
250	1,03	1,0
315	1,34	
400	1,80	
500	2,18	2,1
630	2,46	
800	2,61	
1000	2,58	2,6
1250	2,62	
1600	2,67	
2000	2,65	2,6
2500	2,55	
3150	2,48	
4000	2,52	2,5
5000	2,45	

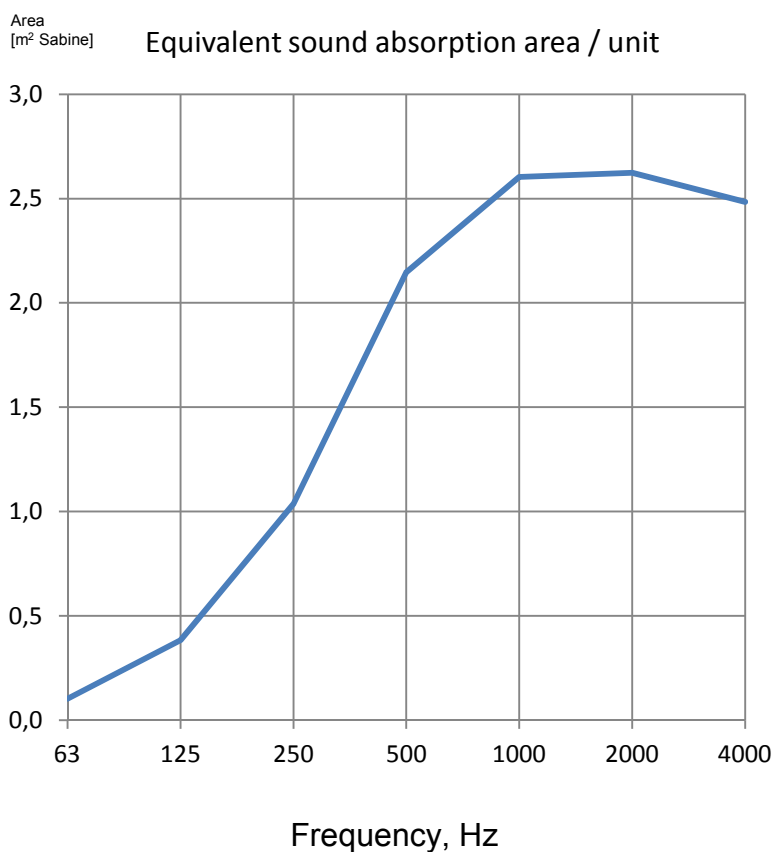

CONDITIONS

Date of test: 2014-09-24 Object area: 2,2 m²
 Date: 2015-07-27 Rev. room volume: 200 m³
 Test report: **Akustikverkstan** report no 14-125-R2 dated 2014-09-29
 Signature: Klas Hagberg